


LABORATORIO PREGEN
 Carrera 15a No 106-42
 BOGOTA

Batch 2176, Rack A, Plate 1, Well C10, 493881
 [CD78AC417ECF991F] Jun 12, 2026 12:57:36 Pressure = 68 bar (68 to 70)

FA

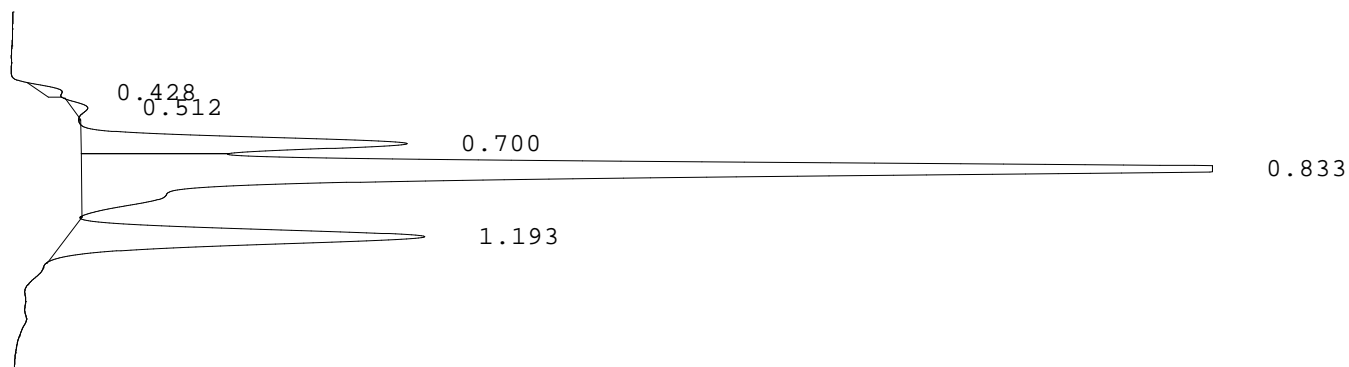

PEAK	RT	REL RT	% CONC	AREA	COMMENT
1	0.428	F 0.51	0.7%	6861	
2	0.512	F 0.61	0.6%	5514	
3	0.700	F 0.83	14.1%	135581	Acetylated F peak
4	0.833	F 0.99	66.6%	638474	Consistent with F
5	1.193	A 1.00	18.0%	172343	A peak
Total Area:				958773	

- Codes:
- 1) Wide A peak
 - 2) Area of A peak < 80%
 - 3) Peak area greater than expected
 - 4) Peak after A2
 - 5) Alc > 10%
 - 6) HbF or variant present
 - 7) Total sample area too small/big
 - 8) A2 is not within normal range